

Installation Manual



Rev. D | 2023.02



CGAS-D Gas Detector

Digital Transmitter

www.critical-environment.com

NEED MORE INFORMATION?

This is the **Installation Manual** for the cGas Detector Digital Transmitter. If you would like it in pdf form, [click here](#) to open and download it from our website.

If you need more information, refer to the **cGAS Detector Operation Manual**, which covers topics such as:

- Relays - enable/disable, set ON/OFF Delays
- Enable/Disable Channels
- Replacing Plug & Play Smart Sensors
- Calibration
- Accessories
- Maintenance
- Troubleshooting

If you would like to view or download the **cGAS Detector Operation Manual** from our website [click here](#)

TABLE OF CONTENTS

1 POLICIES	5
1.1 Important Note	5
1.2 Warranty Policy	6
1.3 Service Policy	6
1.4 Copyrights	7
1.5 Disclaimer	7
1.6 Revisions	8
2 INTRODUCTION	9
2.1 General Description	9
2.2 Key Features	9
3 INSTRUMENT SPECIFICATIONS	11
3.1 Technical Specifications	11
3.2 Enclosure Dimensions	15
4 SENSOR SPECIFICATIONS	16
4.1 Single Channel Gas Sensor Options	16
4.2 Dual Channel Gas Sensor Options	20
4.3 ESH-A-Remote Sensor Options	22
4.4 Calibration Extending Firmware (CEF) and Sensor Aging	22
5 INSTRUMENT FEATURES	23
5.1 Exterior Enclosure	23
5.2 Interior System Layout	24
6 INSTALLATION	25
6.1 Special Considerations for Different Types of Sensors	25
6.2 General Safety Warnings	26
6.3 Protection Against Electrical Risks	26

6.4 Protection Against Mechanical Risks	27
6.5 Mounting the Transmitter	28
6.5.1 Wet Environment Considerations	28
6.5.2 EMI and RF Interference Considerations	29
6.5.3 Mounting Heights (sensor and application dependent).....	29
6.6 Enclosure Mounting Components	33
6.6.1 Enclosure Base.....	33
6.6.2 Enclosure Bottom	34
6.7 Wiring Connections	34
6.7.1 Digital Wire Gauge vs Run Length	37
6.7.2 Wiring the Relay.....	39
6.7.3 ESH-A Remote Sensor Wiring Connection.....	40
6.8 Power Draw Consumption Chart	42
7 BASIC SYSTEM OPERATION	43
7.1 Power-up and Warm-up Process from Factory	43
7.2 Navigating the Menu Structure	44
7.3 Accessing the Menu with Passcodes.....	45
7.4 Display Settings.....	45
7.4.1 Adjust Display Brightness	46
7.4.2 Display Configurations.....	46
7.5 Alarm Status, Fault Detection and Communication Failure Alerts ...	47
7.6 Change Units (°C or °F) of Temperature Readings.....	48
7.7 Temperature and/or Relative Humidity Offset	49
7.8 Test Functions.....	50
7.8.1 Test Readings / Digital Output	50
7.8.2 Test Relay and Buzzer (if installed)	51
8 TROUBLE SHOOTING	52

1 POLICIES

1.1 Important Note

Read and understand this manual prior to using this instrument. Carefully read the warranty policy, service policy, notices, disclaimers and revisions on the following pages.

This product must be installed by a qualified electrician or factory trained technician and according to instructions indicated in this manual. This instrument should be inspected and calibrated regularly by a qualified and trained technician.

This instrument has not been designed to be intrinsically safe. For your safety, **do not** use it in classified hazardous areas (explosion-rated environments).

INSTRUMENT SERIAL NUMBER:

PURCHASE DATE:

PURCHASED FROM:

1.2 Warranty Policy

Critical Environment Technologies Canada Inc. warrants the products we manufacture (excluding sensors, battery packs, batteries, pumps, and filters) to be free from defects in materials and workmanship for a period of two years from the date of purchase from our facility. Sensors are consumable items and once they leave our factory, we cannot reuse or resell them. As such, all sensor sales are final. Should the sensor itself be faulty, there is a one-year pro-rated warranty that would apply from the date of purchase from our facility.

The warranty status may be affected if the instrument has not been used and maintained as per the instructions in the manual or has been abused, damaged, or modified in any way. The product is only to be used for the purposes stated in the manual. Critical Environment Technologies is not liable for auxiliary interfaced equipment or consequential damage.

Prior to shipping equipment to CETCI, contact our office for an RMA #. All returned goods, regardless of reason, must be accompanied with an RMA number. Please read our Warranty and Returns Policy and follow our RMA Instructions and Form.

Due to ongoing research, development, and product testing, the manufacturer reserves the right to change specifications without notice. The information contained herein is based on data considered accurate. However, no warranty is expressed or implied regarding the accuracy of this data.

1.3 Service Policy

CETCI maintains an instrument service facility at the factory. Some CETCI distributors / agents may also have repair facilities; however, CETCI assumes no liability for service performed by anyone other than CETCI personnel.

Repairs are warranted for 90 days after date of shipment (sensors have individual warranties). Should your instrument require non-warranty repair, you

may contact the distributor from whom it was purchased or you may contact CETCI directly.

Prior to shipping equipment to CETCI, contact our office for an RMA #. All returned goods, regardless of reason, must be accompanied with an RMA number. Please read our Warranty and Returns Policy and follow our RMA Instructions and Form.

If the product is deemed repairable, for liability reasons, CETCI will perform all necessary repairs to restore the instrument to its full operating condition.

1.4 Copyrights

This manual is subject to copyright protection; all rights are reserved. Under international and domestic copyright laws, this manual may not be copied or translated, in whole or in part, in any manner or format, without the written permission of CETCI.

Modbus® is a registered trademark of Gould Inc. Corporation.

BACnet® is a registered trademark of American Society of Heating, Refrigeration and Air Conditioning (ASHRAE).

1.5 Disclaimer

Under no circumstances will CETCI be liable for any claims, losses or damages resulting from or arising out of the repair or modification of this equipment by a party other than CETCI service technicians, or by operation or use of the equipment other than in accordance with the printed instructions contained within this manual or if the equipment has been improperly maintained or subjected to neglect or accident. Any of the forgoing will void the warranty.

Under most local electrical codes, low voltage wires cannot be run within the same conduit as line voltage wires. It is CETCI policy that all wiring of our

products meet this requirement. It is CETCI policy that all wiring be within properly grounded (earth or safety) conduit.

1.6 Revisions

This manual was written and published by CETCI. The manufacturer makes no warranty or representation, expressed or implied including any warranty of merchantability or fitness for purpose, with respect to this manual.

All information contained in this manual is believed to be true and accurate at the time of printing. However, as part of its continuing efforts to improve its products and their documentation, the manufacturer reserves the right to make changes at any time without notice. In addition, due to improvements made to our products, there may be information in this manual that does not exist in the version of the product the user has. Should you detect any error or omission in this manual, or should you want to inquire regarding upgrading the device's firmware, please contact CETCI at the following address:

Critical Environment Technologies Canada Inc.
Unit 145 - 7391 Vantage Way,
Delta, BC V4G 1M3 Canada

Toll Free: +1.877.940.8741
Telephone: +1.604.940.8741
Email: sales@cetci.com
Website: www.critical-environment.com

In no event will CETCI, its officers or employees be liable for any direct, special, incidental or consequential damages resulting from any defect in any manual, even if advised of the possibility of such damages.

2 INTRODUCTION

2.1 General Description

Thank you for purchasing our cGas Detector Transmitter. The cGas Detector is a one or two channel gas detection transmitter that offers flexible customization options with the purpose of meeting your specific application and budgetary requirements. Ideal for monitoring toxic, combustible and refrigerant gases in non-hazardous (non-explosion rated) environments such as enclosed parking facilities, commercial HVAC, greenhouses, recreational facilities, refrigeration plants, manufacturing plants and other light industrial applications.

The sensors utilized in this device are accurate enough to measure to Occupational Health & Safety (OHS) hazardous levels for toxic gases. The transmitter operates by diffusion.

2.2 Key Features

- 1 or 2 gas channel operation
- User configurable Modbus® RS-485 RTU or BACnet® MS/TP for communication with a Controller or Building Automation System (BAS)
- Easy Plug & Play Smart sensor replacement at end of life
- Pre-calibrated replacement sensors
- Customizable sensor and option combinations to meet specific application requirements
- 24 volt DC or (ground referenced) AC power
- 4-conductor shielded network wiring (daisy-chain)
- In-field upgradable firmware/configuration via USB stick
- LCD display
- Optional low temperature package for improved usability in cold

environments*

- Optional Relative Humidity and Temperature sensor
- One SPDT dry contact relay with internal buzzer**
- Optional SPDT dry contact relay, rated 30 volts, 2 amps***
- Optional splash guard, factory installed, IP54 rated enclosure
- Optional splash guard for sticky gas sensors, factory installed
- Standard water / dust tight, corrosion resistant enclosure (drip proof)
- Copper coated interior to reduce RF interference
- RoHS compliant circuit boards
- Auto resetting fuse

***Option -LT**

- A low temperature package with OLED display and internal heater for cold environment applications down to -40°C / -40°F
- Available with all models except CGAS-A-EETO

****Option -RBZ**

- 1 SPDT relay rated 30 volts, 2 amp max with internal buzzer rated 90 dB @ 10 cm / 4 in
- Comes standard in CGAS models with a 7 series electrochemical sensor, IR refrigerant sensor or CO2 sensor
- Available as an option for CGAS models with a 4 series electrochemical sensor, combustible (catalytic) sensor, solid state refrigerant sensor or PID sensor

*****Option -RLY**

- 1 SPDT dry contact relay, rated 30 volts, 2 amps max
- Available as an option with single channel models with a 4 series electrochemical sensor, combustible (catalytic) sensor, solid state refrigerant sensor or PID sensor

NOTES:

All 4 series sticky gas sensor models cannot have a relay and buzzer.

All 7 series toxic and sticky gas models come standard with a relay and buzzer.

If after reading through the manual, you have any questions, please do not hesitate to contact our Technical Support department at help@cetci.com.

3 INSTRUMENT SPECIFICATIONS

3.1 Technical Specifications

MECHANICAL

Enclosure	ABS / Polycarbonate, IP54 rating with splash guard installed. Copper coated interior to reduce RF interference.
Weight	400 g / 14 oz
Size	127 mm x 127 mm x 71 mm / 5.0 in x 5.0 in x 3.0 in
Conduit Entry Points	12.7 mm / 1/2 in diameter
Mounting Holes	4.47 mm / 0.175 in diameter maximum head diameter 8 mm / 0.32 in #8 or 4 mm screw

USER INTERFACE

Display (standard)	2-line by 16-character graphic LCD, user configurable to suppress reading display and/or alter brightness
Display (Option -LT)	Optional OLED display for improved usability in low temperature applications, 2-line by 16-character

USB Port	Internal port for USB memory stick connection for in field configuration updates and firmware upgrades
Push Buttons	Initiate calibration and menu options with internal UP, DOWN and ENTER push buttons
Audible Alarm	Rated 90dB @ 10 cm / 4in, user enable/disable Comes standard with all 7 series electrochemical, IR refrigerant sensors, carbon dioxide sensor models. Can be added as Option -RBZ to other models.

ELECTRICAL

Power Requirement	16 - 30 VDC, 3 W*, Class 2 12 - 27 VAC, 50-60 Hz, 3 VA, Class 2 24V recommended. Refer to Section 6.7 <i>Wiring Connections</i> *dependent on sensor type. Refer to Section 6.8 <i>Power Draw Requirements</i>
Digital Wiring	VDC or VAC (ground referenced) four-conductor shielded 16 AWG stranded within conduit, network wiring (daisy-chain)
Fuses	Automatic resetting thermal

INPUT/OUTPUT

Communication Modbus® RTU (version 1.1b3) RS-485	Modbus® ID: 100* (default, configurable) Baud rate: 19,200 (default, configurable) Data bits: 8 Start bits: 1 Stop bits: 1 Parity: none, odd or even
Communication BACnet® MS/TP (version 1 rev 14) RS-485	BACnet® MS/TP; ANSI/ASHRAE standard 135 BACnet® Communication protocol: 135-2012 Baud Rate: 76,800 (default, configurable) Base Address: 270 (default, configurable) MAC Address: 100* (default, configurable) Parity: none (default, configurable) Stop bits: 1 Data bits: 8 <small>*100 is the default for transmitters only</small> <small>*101 increasing sequentially is the default for a system controller and transmitters</small>
Relay & Buzzer (Standard and Option -RBZ)	1 SPDT relay rated 30 volts, 2 amp max with internal buzzer rated 90 dB @ 10 cm / 4 in, enable/disable
Relay (Option -RLY)	1 SPDT relay rated 30 volts, 2 amp max
RH and Temperature (Option -RHT)	User selectable units (°C or °F), user selectable display or hide readings

ENVIRONMENTAL

Operating Temperature	0°C to 40°C / 32°F to 104°F (standard) -40°C to 40°C / -40°F to 104°F (with Option -LT)
Operating Humidity	15 - 90% RH non-condensing
Pollution Degree	Degree 2
Altitude	below 2,000 m

CERTIFICATION


Model: CGAS-D-XXX
S/N: CGASD1807B00010
Rating: 16-30 VDC, 3W, Class 2
12-27 VAC, 50-60 Hz, 3VA, Class 2



CERTIFIED FOR ELECTRIC SHOCK & ELECTRICAL FIRE HAZARD ONLY. LA CERTIFICATION ACNOR COUVRE UNIQUEMENT LES RISQUES DE CHOC ELECTRIQUE ET D'INCENDIE D'ORIGINE ELECTRIQUE.

Conforms to: CSA-C22.2 No. 205-12, UL508 (Edition 18):2018
Conforms to: EMC Directive 2014/30/EU, EN 50270:2015, Type 1, EN61010
Conforms to: FCC. This device complies with part 15 of the FCC Rules,
Operation is subject to the following two conditions: (1) This device may not cause harmful interference, and (2) this device must accept any interference received, including interference that may cause undesired operation.

3.2 Enclosure Dimensions

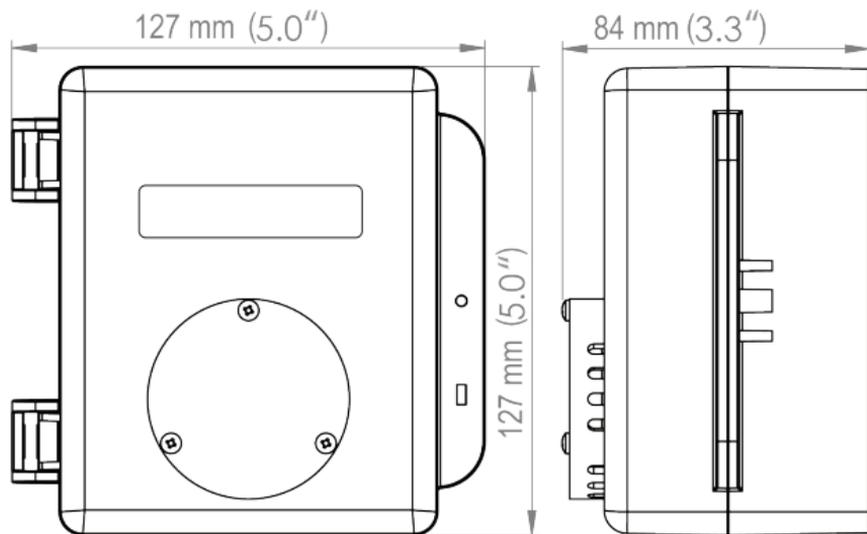

Above dimensions are shown with optional standard splash guard. Without splash guard, thickness is 71 mm / 3.0 in. The area required for enclosure door to be open 90 degrees is 178 mm / 7.0 in or 254 mm / 10.0 in for fully open. With the optional splash guard installed, the enclosure is IP54 rated.

NOTE: During calibration, the sensor response time will be slower with a splash guard installed.

NOTE: The standard splash guard (Option -S) is optional for protecting non sticky gas sensors in wash down applications. For sticky gas sensors such as Chlorine (Cl_2), Chlorine Dioxide (ClO_2), Hydrogen Chloride (HCL), Hydrogen Cyanide (HCN), Hydrogen Fluoride (HF), Ozone (O_3) and Phosphine (PH_3) order

the sticky gas splash guard Option -SN or use the metal splash guard p/n: SCS-8000-WSG.

4 SENSOR SPECIFICATIONS

4.1 Single Channel Gas Sensor Options

Internal 4 Series Electrochemical Sensors	Part Number	Range	Lifespan
Carbon Monoxide (CO)	CGAS-D-CO ¹	0 - 200 ppm	~3+ yrs
Ethylene Oxide (C ₂ H ₄ O)	CGAS-D-EETO	0 - 20 ppm	~2 yrs
Formaldehyde (CH ₂ O)	CGAS-D-CH2O	0 - 5 ppm	~2 yrs
Hydrogen (H ₂)	CGAS-D-EH2	0 - 2,000 ppm	~2 yrs
Hydrogen Sulphide (H ₂ S)	CGAS-D-H2S	0 - 50 ppm	~2 yrs
Nitric Oxide (NO)	CGAS-D-NO	0 - 100 ppm	~2 yrs
Nitrogen Dioxide (NO ₂)	CGAS-D-NO2	0 - 10 ppm	~3+ yrs
Oxygen (O ₂)	CGAS-D-O2	0 - 25% Vol	~3 yrs
Sulphur Dioxide (SO ₂)	CGAS-D-SO2	0 - 20 ppm	~2 yrs

Internal 4 Series Sticky Gas Sensors	Part Number	Range	Lifespan
Chlorine (Cl ₂)	CGAS-D-CL2	0 - 5.0 ppm	~3 yrs
	CGAS-D-CL2-10	0 - 10 ppm	~3 yrs

Chlorine Dioxide (ClO ₂)	CGAS-D-CLO2	0 - 1 ppm	~2 yrs
Fluorine (F ₂)	CGAS-D-F2	0 - 1 ppm	~2 yrs
Hydrogen Chloride (HCl)	CGAS-D-HCL	0 - 30 ppm	~2 yrs
Hydrogen Cyanide (HCN)	CGAS-D-HCN	0 - 30 ppm	~2 yrs
Hydrogen Fluoride (HF)	CGAS-D-HF	0 - 10 ppm	~2 yrs
Ozone (O ₃)	CGAS-D-O3	0 - 1 ppm	~2 yrs

Internal 7 Series Electrochemical Sensors	Part Number	Range	Lifespan
Ammonia (NH ₃)	CGAS-D-7NH3	0 - 500 ppm	~2 yrs
Carbon Monoxide (CO)	CGAS-D-7CO	0 - 200 ppm	~6 yrs
Chlorine (Cl ₂)	CGAS-D-7CL2	0 - 5.0 ppm	~3 yrs
	CGAS-D-7CL2-10	0 - 10 ppm	~3 yrs
Chlorine Dioxide (ClO ₂)	CGAS-D-7CLO2	0 - 1 ppm	~2 yrs
Ethylene (C ₂ H ₄) *	CGAS-D-7C2H4	0 - 200 ppm	~2 yrs
Fluorine (F ₂)	CGAS-D-7F2	0 - 1 ppm	~2 yrs
Hydrogen Chloride (HCl)	CGAS-D-7HCL	0 - 30 ppm	~2 yrs
Hydrogen Cyanide (HCN)	CGAS-D-7HCN	0 - 30 ppm	~2 yrs
Hydrogen Fluoride (HF)	CGAS-D-7HF	0 - 10 ppm	~2 yrs

Hydrogen Sulphide (H ₂ S)	CGAS-D-7H2S	0 - 50 ppm	~2 yrs
Nitrogen Dioxide (NO ₂)	CGAS-D-7NO2	0 - 10 ppm	~6+ yrs
Ozone (O ₃)	CGAS-D-7O3	0 - 1 ppm	~2 yrs

Internal Infrared Sensors	Part Number	Range	Lifespan
Carbon Dioxide (CO ₂)	CGAS-D-CO2-2K	0 - 2,000 ppm	~ 8 yrs
	CGAS-D-CO2-5K	0 - 5,000 ppm	
	CGAS-D-CO2-10K	0 - 10,000 ppm	
	CGAS-D-CO2-5%	0 - 5% vol	
	CGAS-D-CO2-20%	0 - 20% vol	
	CGAS-D-CO2-100%	0 - 100% vol	
Refrigerants: R134A, R143A, R22, R32, R227ea, R402A, R404A, R407A, R407C, R407F, R410A, R417A, R422A, R422D, R427A, R434A, R438A, R442A, R448A, R449A, R450A, R452A, R453A, R454A, R454B, R455A, R507A, R513A, R514A, R1234YF, R1234ZE, R1233ZD	CGAS-D-IR134A CGAS-D-IR143A CGAS-D-IR22 CGAS-D-IR32 etc.	0 - 2,000 ppm	~8 yrs
Refrigerant RSF6	CGAS-D-IRSF6	0 - 1,000 ppm	~8 yrs

Internal Solid State Sensors	Part Numbers	Range	Lifespan
Refrigerants: R134A, R22, R32, R402A, R404A, R407C, R407F, R410A, R422A, R422D, R427A, R438A, R448A, R449A, R450A, R452A, R507A, R513A, R514A	CGAS-D-SR134A CGAS-D-SR22 CGAS-D-SR32 etc.	0 - 2,000 ppm	~5 yrs
TVOC (Isobutylene)	CGAS-D-STVOC	0 - 500 ppm	~5 yrs

Internal Catalytic (Combustible) Sensors	Part Number	Range	Lifespan
Butane (C ₄ H ₁₀)	CGAS-D- CC4H10-100	0 - 100% LEL	~5 yrs
Ethanol or Dimethyl Ether (C ₂ H ₆ O)	CGAS-D- CC2H6O-100	0 - 100% LEL	~5 yrs
Ethane (C ₂ H ₆)	CGAS-D- CC2H6-100	0 - 100% LEL	~5 yrs
Hydrogen (H ₂)	CGAS-D-CH2-100	0 - 100% LEL	~5 yrs
Methane (CH ₄)	CGAS-D-CCH4-100	0 - 100% LEL	~5 yrs
Methanol (CH ₄ O)	CGAS-D- CCH4O-100	0 - 100% LEL	~5 yrs
Propane (C ₃ H ₈)	CGAS-D- CC3H8-100	0 - 100% LEL	~5 yrs

Internal PID Sensors	Part Number	Range	
TVOC	CGAS-D-SPL	0 - 30 ppm	usage / application dependent
TVOC	CGAS-D-SPH	0 - 300 ppm	

Internal RH & Temp Sensor	Part Number
Relative Humidity and Temperature	CGAS-D-RHT

No Internal Sensor	Part Number
Add a remote ESH-A sensor	CGAS-D-R
Add a remote analog transmitter	CGAS-D-RT

4.2 Dual Channel Gas Sensor Options

Two Internal Electrochemical Sensors (4 Series)	Part Number	Range	Lifespan
Carbon Monoxide (CO) and Nitrogen Dioxide (NO ₂)	CGAS-D-CO-NO2 ¹	0 - 200 ppm 0 - 10 ppm	~6 yrs ~3+ yrs

Carbon Monoxide (CO) and Ethylene (C ₂ H ₄)	CGAS-D-CO-C2H4 ¹	0 - 200 ppm	~6 yrs ~2 yrs
Carbon Monoxide (CO) and Hydrogen Sulphide (H ₂ S)	CGAS-D-CO-H2S ¹	0 - 200 ppm 0 - 50 ppm	~6 yrs ~2 yrs
Carbon Monoxide (CO) and Oxygen (O ₂)	CGAS-D-CO-O2 ¹	0 - 200 ppm 0 - 25% vol	~6 yrs ~3 yrs
Carbon Monoxide (CO) and Nitric Oxide (NO)	CGAS-D-CO-NO ¹	0 - 200 ppm 0 - 100 ppm	~6 yrs ~3 yrs
Hydrogen Sulphide (H ₂ S) and Sulphur Dioxide (SO ₂)	CGAS-D-H2S-SO2	0 - 50 ppm 0 - 20 ppm	~2 yrs

¹UL2075 Approved Carbon Monoxide sensor is available except for dual channel configurations that have Option -RHT.

One Internal Sensor and One Remote Sensor

Part Number

Choose internal sensor
and add remote ESH-A
sensor

CGAS-D-____-R
add ESH-A

Choose internal sensor
and add remote analog
transmitter

CGAS-D-____-RT
add ESH-A

4.3 ESH-A Remote Gas Sensor Options

Catalytic Sensors	Part Number	Range	Lifespan
Acetylene (C ₂ H ₂)	ESH-A-CC2H2-100	0 - 100% LEL	~5 years
Hydrogen (H ₂)	ESH-A-CH2-100	0 - 100% LEL	~5 years
Methane (CH ₄)	ESH-A-CCH4-100	0 - 100% LEL	~5 years
Propane (C ₃ H ₈)	ESH-A-CC3H8-100	0 - 100% LEL	~5 years

Infrared Sensors	Part Number	Range	Lifespan
Propane (C ₃ H ₈)	ESH-A-JET	0 - 100% LEL	~8 years

PID Sensors	Part Number	Range	Lifespan
TVOCs	ESH-A-SPL	0 - 30 ppm	usage / application dependent
	ESH-A-SPH	0 - 300 ppm	

4.4 Calibration Extending Firmware (CEF) and Sensor Aging

The cGas Detector with integral electrochemical sensor(s) have been programmed with our CEF. This firmware takes into consideration the aging of the electrochemical CO and NO₂ sensors so that less frequent calibrations are required in less-critical applications such as parking garages. The system tracks the age of the sensor and automatically compensates for the reduced output of the sensor as it ages.


5 INSTRUMENT FEATURES

5.1 Exterior Enclosure



NUMBER	FEATURE	FUNCTION
1	Door Hinge	Secures door to base and allows easy opening and closing
2	Display	LCD display (standard display)
3	Sensor Opening	Allows gas diffusion into sensor
4	Door Screw	Secures door shut
5	Lock Slot	For security padlock or tie

5.2 Interior System Layout

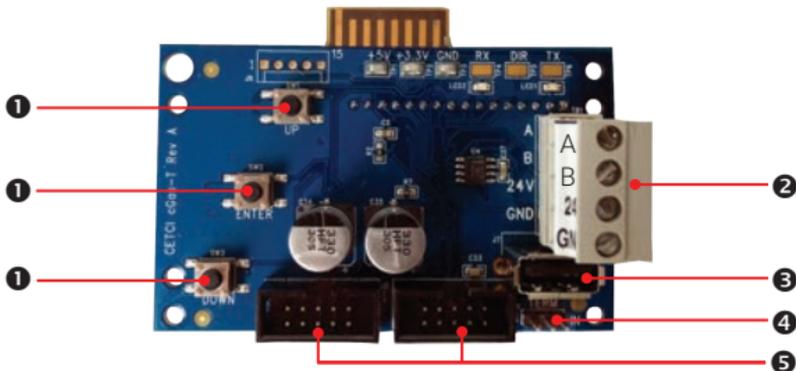

NUMBER	FEATURE	FUNCTION
1	Programming Buttons	Access menu options and program functions using buttons inside the enclosure. (Arrow up, Enter, Arrow down)
2	RS-485 Communication Terminals	Pluggable power and signal terminal for connection to controller and next transmitter.
3	USB Connection	For firmware and configuration upgrades
4	Termination Resistor	Network termination resistor. "IN" position includes 120 ohm resistor.
5	Sockets for sensors and Options boards	Sensor boards and Options boards plug into the main board using these sockets

6 INSTALLATION

The sensor(s) in the cGas Detector go through a burn in period at our factory prior to shipping so it is ready for operation upon arrival. When installing the cGas Detector for the first time, the sensor may require a long warm up time (24 to 48 hours) to stabilize and provide accurate readings.

NOTE: CETCI suggests that upon power-up, all sensors* be left to warm up for 24 hours prior to considering the gas readings to be accurate.

***except, Ammonia which should be left to warm up for 48 hours.**

NOTE: All sensors are calibrated in the factory and **should not require calibration** at the time of a routine installation or replacement.

NOTE: If the sensor is being used in an extreme temperature range, calibration should be done in that same temperature range.

6.1 Special Considerations for Different Types of Sensors

If the cGas Detector is being installed in an environment that is significantly hotter or colder than ambient room temperature, you may want to do a full calibration. While the cGas Detector has built in temperature compensation, it is best practice to calibrate in the environment in which the device is operating.

After installing a cGas Detector with an Oxygen sensor, leave it to warm up for 2 - 6 hours before looking at the readings. If after a minimum of 24 hours the gas reading is not 20.9%, you should do a respan.

After a substantial warm up period, an Ethylene Oxide sensor should be zeroed on site if the ambient temperature is above 22°C (71.6°F). This particular sensor has a drift factor that can be as much as 1 ppm if the temperature rises to 25°C (77°F). With the low set point you could experience false alarms.

Ammonia sensors should be left to warm up for 48 hours so the sensor can stabilize.

Ozone sensors are sensitive and may be reactive to temperature changes causing them to drift.

Silicone, lead and chlorinated hydrocarbon vapours can poison catalytic sensors.

A bump test will help you determine if a sensor requires calibration. If the sensor still does not respond as it should after a successful calibration, it probably requires replacing.

6.2 General Safety Warnings

The cGas Detector is intended for indoor use, permanently mounted at a height that is appropriate for the type of gas being monitored. Refer to *Section 6.5 Mounting the Transmitter*. The cGas Detector should be protected from extreme weather conditions.

The cGas Detector requires no assembly and virtually no maintenance other than regular calibration of the internal and/or remote sensors and ensuring that excess water or dust are not somehow entering the enclosure and physically damaging the circuit board or internal components. There are no serviceable elements other than the calibration instructions outlined in this manual. There are no replaceable components except the plug and play smart sensor boards.

6.3 Protection Against Electrical Risks

Disconnect all power before servicing. There may be multiple power sources. Power supply may have a building installed circuit breaker / switch that is suitably located and easy to access when servicing is required and should be labelled as cGas Detector supply (disconnecting power to the cGas Detector).

Appropriate markings should be visible at the circuit breaker / switch that is supplying power to the cGas Detector.

This device may interfere with pacemakers. Modern pacemakers have built-in features to protect them from most types of interference produced by other electrical devices you might encounter in your daily routine. If you have a pacemaker, follow your healthcare provider's instructions about being around this type of equipment.

6.4 Protection Against Mechanical Risks

The door of the enclosure can be removed if absolutely necessary to facilitate installation of the base but it is not recommended on this model. Extreme care and caution must be exercised when removing the door to avoid damaging the hinges. **The door should only be removed when absolutely required. Any damage occurring from door removal procedure will not be covered under warranty.**

If the unit is installed on a wall or column, open the enclosure fully, grasp the door, keeping it open and being careful not to make contact with any of the internal components (circuit board). If the base is not mounted, grasp the base with your other hand. Tug on the door, pulling towards you making sure the door is still open and straight. **DO NOT TWIST.** The section of the hinges located on the base should "snap" apart from the part of the hinges located on the door.

After installation, place the door hinges over the installed base hinges, with the unit fully open and push towards the wall. The hinges should easily "snap" back into place.

The enclosure has one screw securing the door to the base for electrical safety and provides an opening to allow the user to apply a padlock or tie wrap if they desire the transmitter to be locked.

Be aware that the hinged door that could potentially pinch fingers and the sharp edges and/or jumper pins on the board could potentially prick or cut fingers if not handled carefully.

6.5 Mounting the Transmitter

The cGas Detector should be installed vertically and upright on a flat surface like a wall or a column. Secure the transmitter using the the four 4.4 mm / 0.175 in diameter mounting holes provided to maintain water tight status.

Care should be taken to ensure that the face of the cGas Detector is not obstructed in order to maximize the sensor's exposure to the environment being monitored. Do not mount the transmitter upside down, sideways or flat on the floor or other surface.

Two ½ in / 12.7 mm conduit entry points are provided in the enclosure. Both are located in the enclosure base. One in the rear of the base and one on the bottom edge of the base. Refer to *Section 6.6 Enclosure Mounting Components*.

The clearance from the PCA to the base enclosure is 12.7 mm / ½ in. **Do not use a conduit connector that has more than 12.7 mm (½ in) of thread length.**

NOTE: When mounting the enclosure, allow enough room to allow the end user to open the door fully to access the internal adjustments.

6.5.1 Wet Environment Considerations

If the cGas Detector is to be installed in a potential hose-down application or any application whereby liquid could be directed towards the sensor opening, the cGas Detector should be ordered with an optional attached splash guard (factory installed).

If used in a wet or wash down application, the conduit hub entering the cGas Detector enclosure must be liquid tight type. Water damage is not covered

under warranty. Any physical damage to the transmitter or interior components that occurs from the installer drilling the installation holes will not be covered under warranty.

6.5.2 EMI and RF Interference Considerations

All electronic devices are susceptible to EMI (Electromagnetic Interference) and RFI (Radio Frequency Interference). Our detectors have been designed to reduce the effects of these interferences and we meet CSA FCC and CE requirements for these type of devices. However there are still circumstances and levels of interference that may cause our equipment to respond to these interferences and cause them to react as if there has been gas detected.

There are some installation procedures that will reduce the likelihood of getting faulty readings:

1. Locate the detectors and controllers out of the way from normal foot traffic and high energy equipment.
2. Confirm the devices are properly grounded using conduit and shielded cabling.
3. Inform operators and technical staff working in the surrounding area to be aware of these possible conditions and that two way radios, cell phones and other electrical equipment may interfere with the response of the gas detectors.

6.5.3 Mounting Heights (sensor and application dependent)

The gas detector needs to be mounted where it will best detect the target gas. Some applications may require some adjustments, but generally speaking, the mounting height will depend on the density of the target gas relative to air.

Heavier than air gases fall towards the floor and collect in low lying areas. Thus heavier than air gas sensors should be mounted 6 in / 15 cm from the floor.

Lighter than air gases float upwards and collect at the ceiling. Lighter than air

sensors should be placed on or near the ceiling. Gases that have a density close to that of air should have the sensors installed in the breathing zone. The breathing zone refers to the area 1.2 - 1.8 m / 4 - 6 ft from the floor, where most human breathing takes place. This is a good default location for sensors, as many gases are often well dispersed in air.

Typical Mounting Height by Gas:


GAS TYPE	MOUNTING HEIGHT	COVERAGE (ft²)	COVERAGE (m²)
Ammonia (NH ₃)	on or near the ceiling	3000	279
Carbon Dioxide (CO ₂)	breathing zone	3000	279
Carbon Dioxide (CO ₂)	breathing zone	3000	279
Carbon Monoxide (CO)	breathing zone	5000 - 7500	465 - 697
Chlorine (Cl ₂)	6 in (15 cm) from floor	3000	279
Ethane (C ₂ H ₆) (combustible)	6 in (15 cm) from floor	3000	279
Propane (C ₃ H ₈) (combustible)	6 in (15 cm) from floor	3000	279
GAS TYPE	MOUNTING HEIGHT	COVERAGE (ft²)	COVERAGE (m²)
Methane (CH ₄) (combustible)	on or near the ceiling	5000	465
Hydrogen (H ₂) (combustible)	on or near the ceiling	5000	465

Ethanol (C ₂ H ₆ O) (alcohol)	6 in (15 cm) from floor	3000	279
Methanol (CH ₄ O) (alcohol)	6 in (15 cm) from floor	3000	279
Hydrogen (H ₂)	application dependent	3000	279
Ethylene (C ₂ H ₄)	breathing zone	5000	465
Fluorine (F ₂)	6 in (15 cm) from floor	3000	279
Formaldehyde (CH ₂ O)	breathing zone	3000	279
Hydrogen Chloride (HCl)	12 in (30 cm) from floor	3000	279
Hydrogen Cyanide (HCN)	12 in (30 cm) from floor	3000	279
Hydrogen Sulphide (H ₂ S)	3 ft (91 cm) from floor	3000	279
Nitric Oxide (NO)	breathing zone	5000	465
Nitrogen Dioxide (NO ₂)	breathing zone	5000	465
GAS TYPE	MOUNTING HEIGHT	COVERAGE (ft²)	COVERAGE (m²)
Oxygen (O ₂)	breathing zone	5000	465
Ozone (O ₃)	6 in (15 cm) from floor	3000	279

Phosphine (PH ₃)	breathing zone	3000	279
Silane (SiH ₄)	breathing zone	3000	279
Sulphur Dioxide (SO ₂)	6 in (15 cm) from floor	3000	279
All freon refrigerants	12 in (30 cm) from floor	3000	279
All freon refrigerants	12 in (30 cm) from floor	3000	279
R123 refrigerant (only)	12 in (30 cm) from floor	3000	279
TVOCs	target gas dependent	3000	279

6.6 Enclosure Mounting Components

6.6.1 Enclosure Base

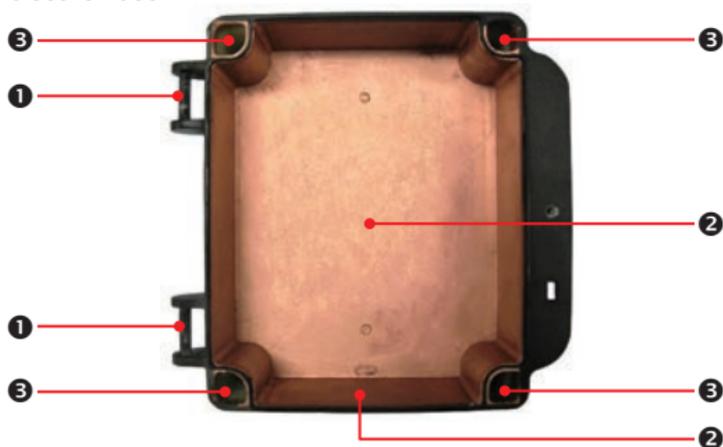

NUMBER	FEATURE
1	Door Hinge
2	Conduit Entry Points 12.7 mm / 1/2 in diameter
3	Mounting Holes 4.47 mm / 0.175 in diameter maximum head diameter 8 mm / 0.32 in, #8 or 4 mm screw

6.6.2 Enclosure Bottom




NUMBER	FEATURE
1	Door Hinge
2	Conduit Entry Points 12.7 mm / 1/2 in diameter

6.7 Wiring Connections

The cGas Detector transmitter is a low voltage powered device. Any application of operating voltages higher than indicated in the specification may result in damage. Double check wiring connections prior to powering the transmitter. Damage from incorrect wiring connections or from too much voltage applied is not covered under warranty.

All wiring should be run in EMT (or better) conduit properly earth grounded. All communications (network) wiring must be in shielded cabling. Wire shielding must be connected together at each device and taped off so it cannot cause a short on the circuit board when the door is closed. The wiring shield should be connected to ground only at the controller, have a contiguous connection throughout the network and be left taped and floating at the last device in the network. **CETCI recommends 4 conductor, 16 AWG, shielded stranded wire cable types like AlphaWire 79220, Belden 5202FE 008500 or equivalent.**

To ensure robust data communications, a daisy chain wiring configuration must be used. No tee taps. No star configurations. This means, four wires run from one end of the digital network to the other, through the same connections along the entire run. From one digital device to the next digital device, A goes to A; B goes to B; GND goes to GND; 24V goes to 24V. Do not mix up the individual wires or the two groups of four wires.

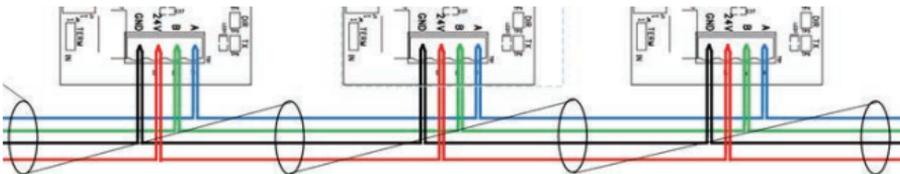


An end of line jumper must be installed at both ends of the digital network. To terminate, you must place a 120 ohm resistor on the IN (or sometimes labelled EN) termination jumper position ON the TERM jumper on the FIRST DIGITAL DEVICE (which might not be the Controller) and the LAST DIGITAL DEVICE in the wire run. The termination resistor jumper on all other digital devices in the network should be in the disabled position. Every CETCI digital device has a termination resistor jumper. The factory default setting of the termination resistor on all digital devices disabled.

The wiring should be 4-conductor shielded 16 awg stranded within conduit in a network wiring (daisy-chain) configuration. Suggested 4-conductor, 16 AWG, shielded stranded wire cable types are AlphaWire 79220, Belden 5202FE 008500 or equivalent.


Wiring Example: 4-Wire VAC

If the cGas Detector is being connected to a BAS, DDC or other control panel then either a 24 VDC power supply or 24 VAC Class 2 or better transformer needs to be used.

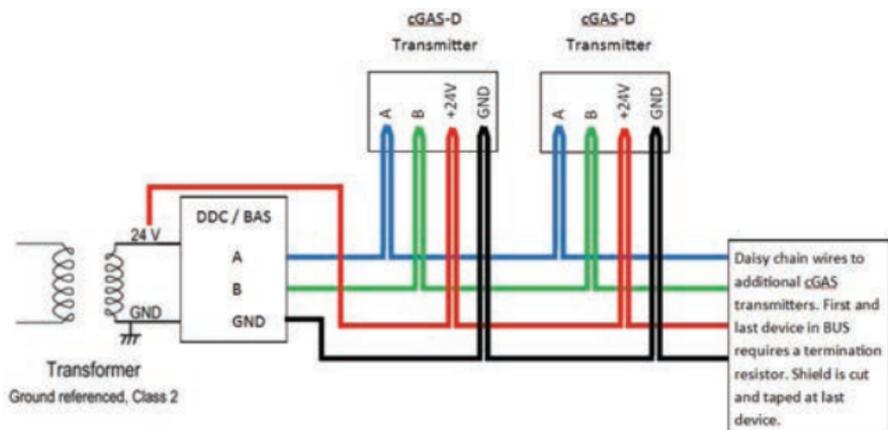

Wiring Example: 4-Wire VDC

If the cGas Detector is being connected to an FCS the supply voltage will be supplied by the FCS and any additional power requirements of the system will be supplied by RPS-24VDC Remote Power Supply devices.

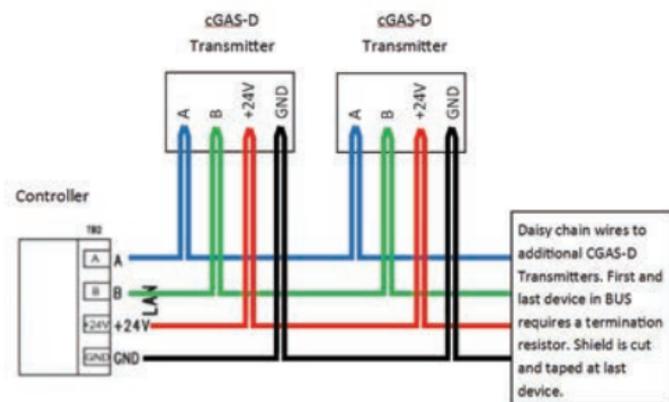

6.7.1 Digital Wire Gauge vs Run Length

It is important to use the appropriate gauge of wire for the required length of the run to ensure sufficient available voltage, noise reduction, dissipation of heat, and overall optimum performance along the entire wire run. Large wire sizes will have less voltage drop than smaller wires sizes of the same length. Similarly, shorter wire lengths will have less voltage drop than longer wires for the same wire size. The longer the wire run, the more attention there should be made to preventing voltage drop. **The addition of an RPS-24VDC Remote Power Supply is recommended as follows:**

For single channel and low consumption dual channel devices, an RPS-24VDC Remote Power Supply should be installed every 32 devices (ie. CGAS-D-CO-NO2). For transmitters connected to ESH-A remote sensors, a remote power supply should be installed every 16 devices (pairs of devices ie. CGAS-D-CO-R + ESH-A-CH2-100).

CETCI strongly recommends a 4-conductor, 16 AWG, shielded, stranded wire cable type such as AlphaWire 79220, AlphaWire 5534, Belden 9954 or equivalent.

NOTE: When wiring transmitters or the FCS WAN to a third party controller / control panel / BAS / DDC and there is a discrepancy between CETCI's recommended wire gauge and the third party specifications, we recommend following the recommendations of the third party.

NOTE: WARRANTY VOID IF SOLID-CORE WIRE IS USED AT THE WIRING TERMINAL STRIP.

When using solid core wiring for distribution (in the conduit), use stranded wire pigtails 14 - 18 AWG within the enclosure to connect to the circuit board. The rigidity of solid-core wire can pull a soldered terminal strip completely off a circuit board and this will not be covered under warranty.

Cable Length, Size (AWG) and Maximum Number of Sensors for Digital Communication and Power Supply between the cGas Detector and the Controller

Cable Length		# of Sensors	4	6	8	10	12	14	16
Meters	Feet								
0 - 152	1 - 500	AWG #	18	18	18	18	18	18	18
153 - 305	501 - 1,000	AWG #	18	18	18	18	18	18	18
306 - 457	1,001 - 1,500	AWG #	18	18	18	16	16	16	16
458 - 914	1,501 - 3,000	AWG #	18	16	16	16	16	16	16

In large system applications, if the recommended maximum cable length needs to be exceeded, an LNK-XT Network Extender can be used to boost the decreasing signal strength. One LNK-XT extends the network length up to an additional 914 m (3,000 ft). It is recommended that an LNK-XT be installed when a drop in signal strength is detected.

6.7.2 Wiring the Relay

The cGas does not provide any power from the relay terminal.

The relay is single pole, double throw thereby providing one set of usable dry contacts for the relay. A dry contact relay operates like a switch to simply activate (switch on) or de-activate (switch off) equipment to be controlled, such as a remote horn and fan starters.

If the relay and buzzer are installed, the SPDT dry contact relay is rated 30 volts, 2 amps max and the internal buzzer is rated 90dB @ 10 cm / 4in.

cGas sensors that come standard with relay and buzzer:

- 7 series electrochemical toxic and sticky gas sensors
- IR refrigerant gas sensors
- Carbon dioxide gas sensors

cGas models that **do not** come standard with a relay and buzzer. If a relay and buzzer is required, you must add **Option RBZ**:


- 4 series electrochemical toxic gas sensors
- Combustible (catalytic) gas sensors
- Solid state refrigerant gas sensors
- PID TVOC gas sensors

If only a relay is needed, **Option RLY** can be added to a single channel model with a:

- 4 series electrochemical toxic gas sensor
- Combustible (catalytic) gas sensor
- Solid state refrigerant gas sensor
- PID TVOC gas sensor

NOTE: 4 series sticky gas sensor **cannot** have a relay and buzzer.

The cGas Detector is designed to be fail-safe. Equipment to be controlled by the relay should be wired to the “NC” (Normally closed) and “COM” (Common) terminals. With this wiring, the connection will be open under normal, low gas concentration conditions. When the gas concentration rises to the configured alarm point or if there is a power failure, the relay NC connection will close to the relay COM. The relay coils are normally energized in a non-alarm state for failsafe operation. Refer to *cGas Detector Operation Manual* for more information on the operation of the relay.

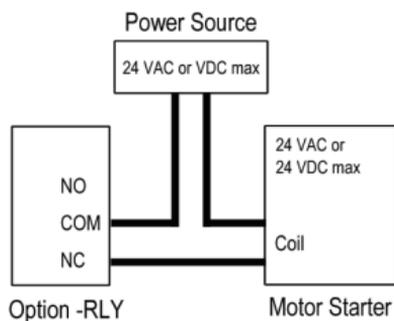


6.7.3 ESH-A Remote Sensor Wiring Connection

Each ESH-A is given the same serial number as the device it is being connected to. Make sure to connect the ESH-A to the CGAS-D that has the same serial number or the cGas factory calibration will be void.

Four-conductor, 16 AWG stranded shielded cable is recommended for the ESH-A remote sensor wiring. This wiring should be run in a conduit, separate from the signal output, and should not exceed 15 m (50 ft). The voltage at the remote sensor (Red V+ to Black GND) should not be below 4.5 volts. If this voltage is not met after installation, the wrong gauge wire may have been used or the wiring run is too long.

Wiring Example: ESH-A Remote Sensor

Note: The maximum length of wire between the ESH-A Remote Sensor and the cGas Detector should not exceed 15 m (50 ft).

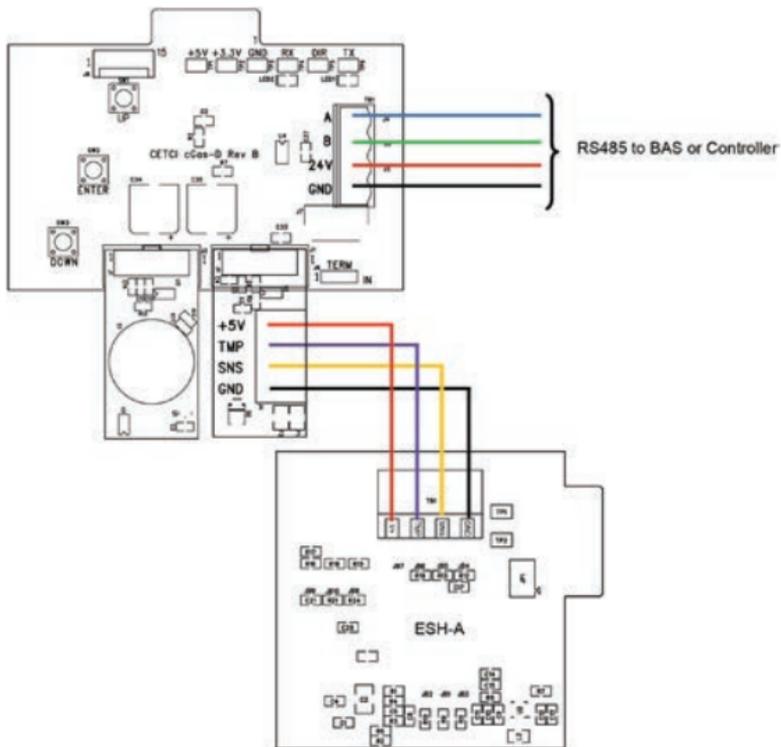

6.8 Power Draw Consumption Chart

CGAS MODEL	PEAK POWER CONSUMPTION
CGAS-D-CO	1.2 watts
CGAS-D-CO2	1.5 watts
CGAS-D-NO2	1.2 watts
CGAS-D-H2S	1.2 watts
CGAS-D-CO-NO2	1.3 watts
CGAS-D-CO-H2S	1.3 watts
CGAS-D-R + ESH-A	2.5 watts
CGAS-D with internal solid state or catalytic sensor	1.5 watts
CGAS-D-IR refrigerant sensor	1.8 watts

Add to Peak Power Consumption if installed:

CGAS Buzzer + Relay (Option -RBZ)	0.7 watts
CGAS Relay (Option -RLY)	0.15 watts

7 BASIC SYSTEM OPERATION

The cGas Detector continuously monitors target gas concentrations on one or two configured channels. It must be connected to a controller, control panel or BAS / BMS / DDC system; the cGas Detector is not a standalone gas detection system.

NOTE: For functions that do not appear in this section, refer to the *cGAS Detector Operation Manual*.

7.1 Power Up and Warm-up Process from the Factory

Upon application of power to a cGas Detector shipped from the factory, the LCD display will turn on and rotate through several info screens that differ depending on the configuration of the transmitter. The warm-up period takes between 2 and 5 minutes depending on the gas sensors type.

NOTE: The cGas Detector will be visible on the controller / BAS / DDC system during the warm-up countdown and will output a default value to prevent alarms. The accurate reading will show up when the unit has finished the warm-up period and the sensor(s) has stabilized.

All alarms will be disabled during the system warm-up period. After the warm-up period, the system may exhibit gas alarm condition(s) if one or both of the sensors has not completely stabilized during the warm up period. This is normal and the length of time the gas alarms exist is dependent upon the length of time since the unit was last powered up, and the state of the environment it is installed in. Refer to *Section 6.1 Special Considerations for Different Types of Sensors* for more information about sensor warm up time.

Upon power-up, all sensors* should be left to warm up for 24 hours prior to considering the gas readings to be accurate.

*except, Ammonia, which should be left to warm up for 48 hours.

All sensors are calibrated in the factory prior to shipping and should not require calibration at the time of a routine installation or replacement.

7.2 Navigating the Menu Structure

The three programming push-buttons inside the enclosure are used to navigate through the cGas Detector menu structure. Refer to *Section 5.1 Exterior Enclosure* for location photo.

ENTER begins a process or moves you to the next screen in the same menu.

The UP or DOWN buttons are used to enter characters/numbers and to navigate to the next menu item. For simplicity's sake, directions in this manual use the UP button.

A line under a character or number indicates that is the space into which you are entering a character or number. Use the ENTER button to move to the next space. Or use the UP or DOWN button to change the value in that space.

The > symbol indicates that you are in the edit mode as opposed to scrolling through available menu items.

After entering and confirming a value you can either Exit the menu or press the UP button to move to the next item in that menu. All menus are circular and will bring you back to the Exit screen. Press ENTER to Exit.

7.3 Accessing the Menu with Passcodes

You have to enter a passcode to access the menu. From the normal operation screen, press ENTER to access the password entry screen. Use the UP or DOWN arrow to scroll to the desired number. Press ENTER to move to the next position. Continue until the full code is entered and press ENTER when finished.

CODE	NAME	DESCRIPTION
0001	Test Menu	<ul style="list-style-type: none">• Test Reading (Digital Output)• Test Relay (if installed)• Test Relay or Buzzer (if installed)
1014	Display Menu	<ul style="list-style-type: none">• Display Type• Brightness• Selected Channel• Hide Channel• Scroll Delay

7.4 Display Settings

The LCD displays up to 2-lines of 16-characters. The factory default during normal operation is for the backlight to be on. This can be turned off in the Display Menu. During normal operation, the display will show the current gas level reading for each configured channel.

Pressing the UP or DOWN button allows you to scroll through a series of information screens showing the model name, serial communication configs, firmware version; the gas type and AD counts; the channel number, gas type and gas level; and temperature and relative humidity (if installed) and relay status (if relay is installed); communication type, ID and baud rate also appear on these screens.

7.4.1 Adjust Display Brightness

The brightness of the display and the information displayed can be changed as per your preference.

From the main display, press ENTER.

Enter passcode 1014 using the UP button and ENTER button.

```
Enter Password
1014
```

Press ENTER to access the Display Menu.

```
DisplayMenu
Press Enter
```

```
Brightness
100
```

Press ENTER. Use the UP button to change the numeric value. Move to the next digit by pressing ENTER. When finished, press ENTER to confirm and Exit.

```
Brightness
>050
```

```
Confirm?      N
50             >Y
```

NOTE: You cannot enter a number higher than 100. Entering a value of 000 turns the backlight off completely. With ambient light the text can still be read on the display.

7.4.2 Display Configurations

The default display set from the factory is normal mode which displays the gas type, gas reading and gas units for CH1.

```
CO           0 PPM
```

The information can be reduced to just the gas type by changing the setting to the minimal mode display.

```
*****-CO*****
```

From the main display, press ENTER.

Enter passcode 1014 using the UP button and ENTER button.

```
Enter Password
1014
```

Press ENTER to access the Display Menu.

DisplayMenu Press Enter

Display Type Normal

Press ENTER. Use the UP button to change the display type and press ENTER to save and Exit.

Display Type >Minimal

7.5 Alarm Status, Fault Detection and Communication Failure Notifications

If a channel is in alarm, the following letters will be displayed at the end of the line for that channel.

- low for low alarm
- mid for mid alarm
- high for High alarm

CO	0 PPM
NO2	0.7 low

CO	0 PPM
NO2	1.0 mid

CO	0 PPM
NO2	1.5 high

The cGas Detector has built in fault detection, and in the event of a problem with the measurement circuitry the transmitter will indicate a fault condition on the display. Normal operation will resume once the fault condition has been corrected.

NOTE: If a question mark ? is displayed, the system is reading slightly negative but not enough to adversely affect the alarm functionality; a re-zeroing is recommended.

If there is a communication failure between the cGas Detector and the controller or BAS, the screen will display COMM at the end of the line.

CO	0 COMM
NO2	0 COMM

For a list of Fault Codes, refer to *Section 8 Troubleshooting*.

7.6 Change Units (°C or °F) of Temperature Readings

NOTE: This menu item only applies if the cGas Detector has the -RHT option installed.

You can change the factory configured temperature unit type from Celsius to Fahrenheit (or vice versa) very easily.

From the main display, press ENTER.

Enter passcode 3032 using the UP button and ENTER button.

Enter Password 3032

Press ENTER to access the Calibrate Menu.

Calibrate Menu Press Enter

In the Selected Channel menu, if Temperature is not displayed, press ENTER and use the UP button to scroll to find Temperature. Press ENTER.

Selected Channel CO

Selected Channel >Temperature

Use the UP button to find Temperature Unit. If you want to change the unit type, press ENTER.

Temperature Unit Celsius

Press the UP button to choose Fahrenheit press ENTER and ENTER to exit.

Temperature Unit >Fahrenheit

Confirm? N
>-4.0 degC >Y

Confirm? N
>+2 %RH >Y

7.7 Temperature and / or Relative Humidity Offset

NOTE: This menu item only applies if the cGas Detector has the -RHT option installed.

NOTE: Depending on the configuration, the device will show the temperature in either Celsius or Fahrenheit. The units can be changed at any time, refer to *Section 7.6 Change Units (°C or °F) of Temperature Readings.*

The temperature and relative humidity sensor is calibrated prior to shipping. If the readings on the cGas Detector are higher or lower than another device measuring the ambient temperature or relative humidity, you can adjust the reading by setting an offset value so the reading is more accurate. The Temperature offset value is a number of degrees in either direction of 0 and the Humidity offset value is a percentage between 0 or 100.

From the main display, press ENTER.

Enter passcode 3032 using the UP button and ENTER button.

Enter Password
3032

Press ENTER to access the Calibrate Menu.

Calibrate Menu
Press Enter

In the Selected Channel menu, if Temperature (or Humidity) is not displayed, press ENTER and use the UP button to scroll to find the item you are looking for. Press ENTER.

Selected Channel
CO

Selected Channel
>Temperature

Selected Channel
>Humidity

Use the UP button to find Temperature Adj (or Humidity Adj). If you want to change the offset value, press ENTER. Change the offset value using the UP or

DOWN and ENTER buttons.

Temperature Adj >-4.0 degC	Humidity Adj >+02 %RH
-------------------------------	--------------------------

Press ENTER to confirm the value is correct. If you entered the wrong value, press the UP button to move the cursor to N and press ENTER and reenter the value.

Confirm? N >-4.0 degC >Y	Confirm? N >+2 %RH >Y
-----------------------------	--------------------------

7.8 Test Functions

7.8.1 Test Reading / Test Digital Output

For each gas channel, you can manually enter a gas reading value of your choice (within the range of the sensor) that will be sent over the digital network to test the connection and configured responses between the cGas Detector and the DDC/BAS. You can do the same for relative humidity and temperature if the -RHT option is installed.

From the main display, press ENTER.

Enter passcode 0001 using the UP button and ENTER button.

Enter Password 0001

Press ENTER to access the Test Menu.

Test Menu Press Enter

In the Selected Channel_menu, confirm the correct channel is showing.

Selected Channel CO

If you want to choose a different channel, press ENTER and use the UP button to scroll to the next value. Press ENTER and continue.

Selected Channel >NO2

The list to choose from will depend on included sensors and options:

- Gas Type (ie. CO)
- Gas Type (ie. NO2)
- Temperature
- Humidity

Press the UP button to find Test Reading. To make a change, press ENTER and then use the UP, DOWN and ENTER buttons to enter the value.

Test Reading 0 PPM NO2

Test Reading >10.0 PPM NO2

Press ENTER and then again to Confirm Y.

Confirm? >10.0 PPM NO2	N >Y
---------------------------	---------

Test Reading 10.0 PPM NO2

The test will start as soon as you press ENTER to confirm. To stop the test, press the UP or DOWN button. To test another analog output value repeat the process by pressing ENTER.

7.8.2 Test Relay or Buzzer (if installed)

NOTE: Before testing the relay, notify the appropriate people so unnecessary distress or response is not caused by activating fans or equipment or inadvertently calling the fire department or other emergency response team.

From the main display, press ENTER.
Enter passcode 0001 using the UP button and ENTER button.

Enter Password 0001

Press ENTER to access the Test Menu.

```
Test Menu
Press Enter
```

Press the UP or DOWN button to scroll to Selected Relay. Choose the relay or the buzzer you want to test.

```
Selected Relay
Left SB Relay
```

```
Selected Relay
>Left SB Buzzer
```

Press the UP or DOWN button to scroll to Test RLY. The default entry is Untripped. Press ENTER and use the UP button to change to Tripped. Press ENTER. You will hear a soft click and the relay will activate accordingly, respecting its failsafe setting.

```
Test RLY:
Untripped
```

```
Test RLY:
>Tripped
```

To stop the relay test, change the entry to Untripped. You will hear a soft click and the relay will deactivate.

```
Test RLY:
>Untripped
```

When finished, press the UP button and press ENTER on the Exit menu item. Repeat the steps with Left SB Buzzer selected to test the buzzer.

8 TROUBLE SHOOTING

cGas Detector won't power up. (blank display) Is the power properly connected? Check the wiring connections. Refer to *Section 6.7 Wiring Connections*.

cGas Detector display shows "COMM" message. Modbus® or BACnet output signal has not been connected properly; will also occur if no requests are being made from the controller to the transmitter, ie addressing is not proper. Check the wiring connections and the network settings.

Device cannot be seen by the Controller and/or the BAS / DDC on the Modbus® network. Check the Baud rate. All devices in the network must have the same Baud rate.

- Check that local area network wiring is correct, especially the A and B lines to make sure they are not swapped between devices on the network.
- Check the Modbus® ID. Each device must have a unique ID assigned to it.

Device cannot be seen by the Controller and/or the BAS / DDC on the BACnet® network.

- Check the Baud rate. All devices in the network must have the same Baud rate.
- Check to make sure the device has a unique ID assigned to it, the factory default is made up of the MAC ID and the Base ID
- Check that local area network wiring is correct, especially the A and B lines to make sure they are not swapped between devices on the network.

Frequent, unexpected alarm reading reported to BAS/DDC. Check to see if EMI and RF interference is causing the equipment to react this way. Refer to *Section 6.5.2 EMI and RF Interference Considerations*.

Error Codes. The error code will appear on the display in place of the units for a channel. See the resolutions provided in the List of Possible cGas Error Codes on the following page.

List of Possible cGas Error Codes

CODE		DESCRIPTION
		The controller or BAs has not read the current gas concentrations in more than the preset time (default 5 minutes).
COMM	Communication Fault	<p>Could be an address Miss-matched between cGAS and controller / BAS. MAC value on MODbus or MAC value or Device ID on BACnet</p> <p>Check for wiring problems. A and/or B wires broken at somewhere in the network or ground connection between cGAS & controller / BAS (using cable shield as ground is not recommended).</p>
F01	Negative Fault Reading	Check to make sure the smart sensor board is present and installed properly in the socket. If installed, the cGas detects the sensor signal is too far below its zeroAD. May be caused by a sensor that is temperature or humidity sensitive or the device wasn't warmed up for a minimum 24 hours. After an appropriate warm up period, zeroing the sensor will normally resolve this.
F03 F07 F11 F12	Sensor Faults	cGas cannot communicate with the sensor. Ensure the smart board is installed correctly. If unresolved, contact our Technical Support Department.

F02 F04 F09 F20	Smart Board Faults	Ensure the smart board is seated properly and installed on the correct side (left) if a single channel unit. If a power cycle does not resolve this, replace the sensor smart board.
F05	Error in reading Smart Board	cGas detected an error in the smart board ID. Use "Write to Sensor" for the indicated channel (passcode 3022).
F06	SB ID Mismatch	Firmware expected a different smart board than what is in the sensor socket.
F07	RH & Temp Fault	cGas cannot communicate with the sensor. Ensure the smart board is installed correctly. A "Write to Sensor" should correct the fault. If unresolved, contact our Technical Support Department
F08	DAC COMM	This is a hardware fault. Contact our Technical Support Department.
F80-99	Internal Memory Faults	The cGAS has detected a critical memory failure of the main board. This can be corrected by bootloading a valid configuration onto the unit. If unresolved, contact our Technical Support Department.

SAFER AIR EVERYWHERE.

www.critical-environment.com

CGAS-D-20230214-Rev-D

Critical Environment Technologies™

Unit 145, 7391 Vantage Way, Delta, BC V4G 1M3 Canada

Tel: +1.604.940.8741 Toll Free: +1.877.940.8741

© 2023 All rights reserved. Data subject to change without notice.